

D.—1.

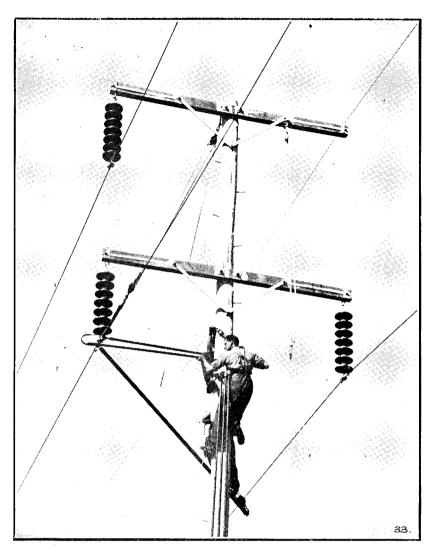

Mangahao Hydro-electric-power Development: Changing Insulators on 110,000-volt Line.

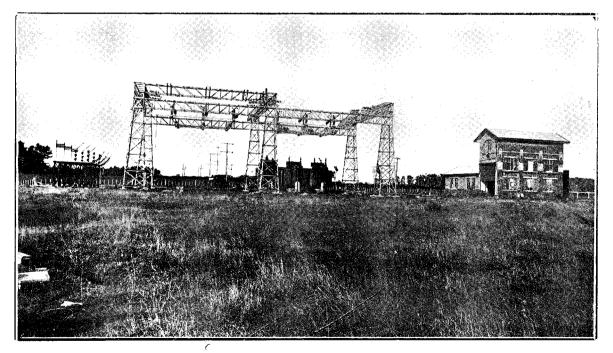

MANGAHAO HYDRO-ELECTRIC-POWER DEVELOPMENT: WANGANUI SUBSTATION.